


株式会社 太陽電機製作所 電力監視 変圧器負荷状況

| 日付 | 最大 デマンド | 受電電力 量KWH | 電灯50KVA 電流デマンド最大値 | | 動力TR100KVA 電流デマンド最大値 | | | 動力TR150KVA 電流デマンド最大値 | | | 曜日 | 気温 °C | | |
|-----------|------------|--------------|-------------------|--------|----------------------|-------|--------|----------------------|-------|--------|-------|-------|------|------|
| | | | R相 | T相 | R相 | S相 | T相 | R相 | S相 | T相 | | 最低 | 最高 | |
| 2016/4/1 | 77.1 | 654 | | 57 | 79.5 | 96.5 | 74.5 | 90.5 | 125.5 | 119 | 131 | 金 | 11.7 | 17 |
| 2016/4/2 | 68.56 | 642 | | 52 | 78 | 92 | 69 | 86.5 | 118 | 101.5 | 119 | 土 | 10.1 | 22.9 |
| 2016/4/3 | 4.72 | 100 | | 9.5 | 19 | 0 | 0 | 0.5 | 0 | 3 | 4.5 | 日 | 12.9 | 22.4 |
| 2016/4/4 | 66.02 | 700 | | 53.5 | 80.5 | 101 | 82 | 94 | 112.5 | 108.5 | 119 | 月 | 10.1 | 15 |
| 2016/4/5 | 71.98 | 644 | | 50 | 84.5 | 97 | 75.5 | 89 | 125.5 | 122 | 130.5 | 火 | 8.1 | 18.1 |
| 2016/4/6 | 69.16 | 696 | | 51.5 | 87.5 | 102 | 82.5 | 98.5 | 122.5 | 111.5 | 125 | 水 | 7.4 | 20.3 |
| 2016/4/7 | 70.18 | 653 | | 54 | 81 | 97.5 | 75.5 | 91 | 118 | 111.5 | 121 | 木 | 11.5 | 19.5 |
| 2016/4/8 | 65.18 | 659 | | 47.5 | 82.5 | 93.5 | 69.5 | 88 | 101.5 | 100 | 106 | 金 | 10 | 20.1 |
| 2016/4/9 | 27.04 | 281 | | 25.5 | 28.5 | 69 | 52.5 | 69 | 24.5 | 23.5 | 28 | 土 | 10.7 | 23.9 |
| 2016/4/10 | 4.42 | 101 | | 9.5 | 21.5 | 0 | 0 | 0 | 3.5 | 3.5 | 3.5 | 日 | 10.1 | 19.7 |
| 2016/4/11 | 75.24 | 695 | | 55 | 78.5 | 108.5 | 85 | 104 | 128 | 123.5 | 132 | 月 | 6.7 | 13.2 |
| 2016/4/12 | 80.9 | 674 | | 60.5 | 85 | 116.5 | 94 | 112 | 122 | 111.5 | 121 | 火 | 4 | 15.1 |
| 2016/4/13 | 65.26 | 650 | | 55.5 | 78.5 | 92.5 | 69.5 | 86.5 | 110.5 | 101 | 110 | 水 | 9.1 | 23 |
| 2016/4/14 | 60.18 | 573 | | 53 | 77.5 | 89.5 | 66.5 | 86 | 113 | 104 | 114 | 木 | 12.7 | 21.3 |
| 2016/4/15 | 62.76 | 600 | | 50 | 82 | 76.5 | 56.5 | 73 | 120.5 | 111 | 122 | 金 | 9.4 | 15.7 |
| 2016/4/16 | 10.4 | 126 | | 10.5 | 19 | 27 | 9.5 | 28 | 0 | 0 | 0 | 土 | 6.4 | 26.9 |
| 2016/4/17 | 4.3 | 100 | | 10 | 17 | 0 | 0 | 3.5 | 0 | 0 | 0 | 日 | 14.1 | 23.5 |
| 2016/4/18 | 66.6 | 649 | | 63 | 78 | 82.5 | 64 | 78.5 | 120.5 | 112 | 123.5 | 月 | 8.4 | 17.2 |
| 2016/4/19 | 73.4 | 644 | | 62.5 | 79 | 94 | 75 | 88.5 | 125.5 | 124 | 136 | 火 | 7.1 | 18.2 |
| 2016/4/20 | 68.54 | 644 | | 56.5 | 81.5 | 84.5 | 68.5 | 82 | 118.5 | 109 | 121.5 | 水 | 6 | 22.8 |
| 2016/4/21 | 66.62 | 759 | | 54 | 76.5 | 87.5 | 79 | 81.5 | 114.5 | 106 | 117.5 | 木 | 14.3 | 18.3 |
| 2016/4/22 | 70.66 | 813 | | 60 | 74 | 91.5 | 69.5 | 85.5 | 132.5 | 127.5 | 140 | 金 | 14.1 | 22.7 |
| 2016/4/23 | 6.82 | 111 | | 30 | 20.5 | 0 | 0 | 0 | 0 | 5.5 | 6.5 | 土 | 12.2 | 18.7 |
| 2016/4/24 | 5.02 | 107 | | 9.5 | 24 | 0.5 | 0 | 1 | 0 | 0 | 0 | 日 | 10.7 | 19.3 |
| 2016/4/25 | 70.4 | 646 | | 62 | 76.5 | 95 | 71 | 88.5 | 123 | 115 | 127 | 月 | 9.6 | 20.6 |
| 2016/4/26 | 68.2 | 622 | | 52 | 76.5 | 83 | 65 | 77.5 | 113.5 | 102 | 114.5 | 火 | 10.1 | 26 |
| 2016/4/27 | 68.38 | 7122 | | 77 | 74.5 | 54 | 66.5 | 117 | 116.5 | 125.5 | 125.5 | 水 | 14.9 | 17.1 |
| 2016/4/28 | 65 | 5826 | | 83 | 90.5 | 67 | 84.5 | 123.5 | 118.5 | 126 | 126 | 木 | 10.1 | 15.2 |
| 2016/4/29 | 9.64 | 1376 | | 50.5 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 金 | 7.7 | 16.8 |
| 2016/4/30 | 4.98 | 1135 | | 23.5 | 0 | 0 | 3 | 0 | 0 | 0 | 0 | 土 | 6.5 | 21.5 |
| | 最大値 KW | 合計 KWH | R相最大値 | T相最大値 | R相最大値 | S相最大値 | T相最大値 | R相最大値 | S相最大値 | T相最大値 | | | | |
| | 80.9 | 29,002 | 83 | 90.5 | 116.5 | 94 | 123.5 | 132.5 | 127.5 | 140 | | | | |
| | | | 最大値 A | 90.5 | 最大値 A | | 123.5 | 最大値 A | | 140 | | | | |
| | | | 定格電流値 A | 238 | 定格電流値 A | | 275 | 定格電流値 | | 412 | | | | |
| | | | 最大使用率 % | 38.03% | 最大使用率 % | | 44.91% | 最大使用率 | | 33.98% | | | | |

2016年4月 最大電力

| 日付 | 最大デマンド KW |
|-------------|---------------|
| 2016/4/1 | 77.1 |
| 2016/4/2 | 68.56 |
| 2016/4/3 | 4.72 |
| 2016/4/4 | 66.02 |
| 2016/4/5 | 71.98 |
| 2016/4/6 | 69.16 |
| 2016/4/7 | 70.18 |
| 2016/4/8 | 65.18 |
| 2016/4/9 | 27.04 |
| 2016/4/10 | 4.42 |
| 2016/4/11 | 75.24 |
| 2016/4/12 | 80.9 |
| 2016/4/13 | 65.26 |
| 2016/4/14 | 60.18 |
| 2016/4/15 | 62.76 |
| 2016/4/16 | 10.4 |
| 2016/4/17 | 4.3 |
| 2016/4/18 | 66.6 |
| 2016/4/19 | 73.4 |
| 2016/4/20 | 68.54 |
| 2016/4/21 | 66.62 |
| 2016/4/22 | 70.66 |
| 2016/4/23 | 6.82 |
| 2016/4/24 | 5.02 |
| 2016/4/25 | 70.4 |
| 2016/4/26 | 68.2 |
| 2016/4/27 | 68.38 |
| 2016/4/28 | 65 |
| 2016/4/29 | 9.64 |
| 2016/4/30 | 4.98 |
| 稼働日数 | 最大値 KW |
| | 80.9 |

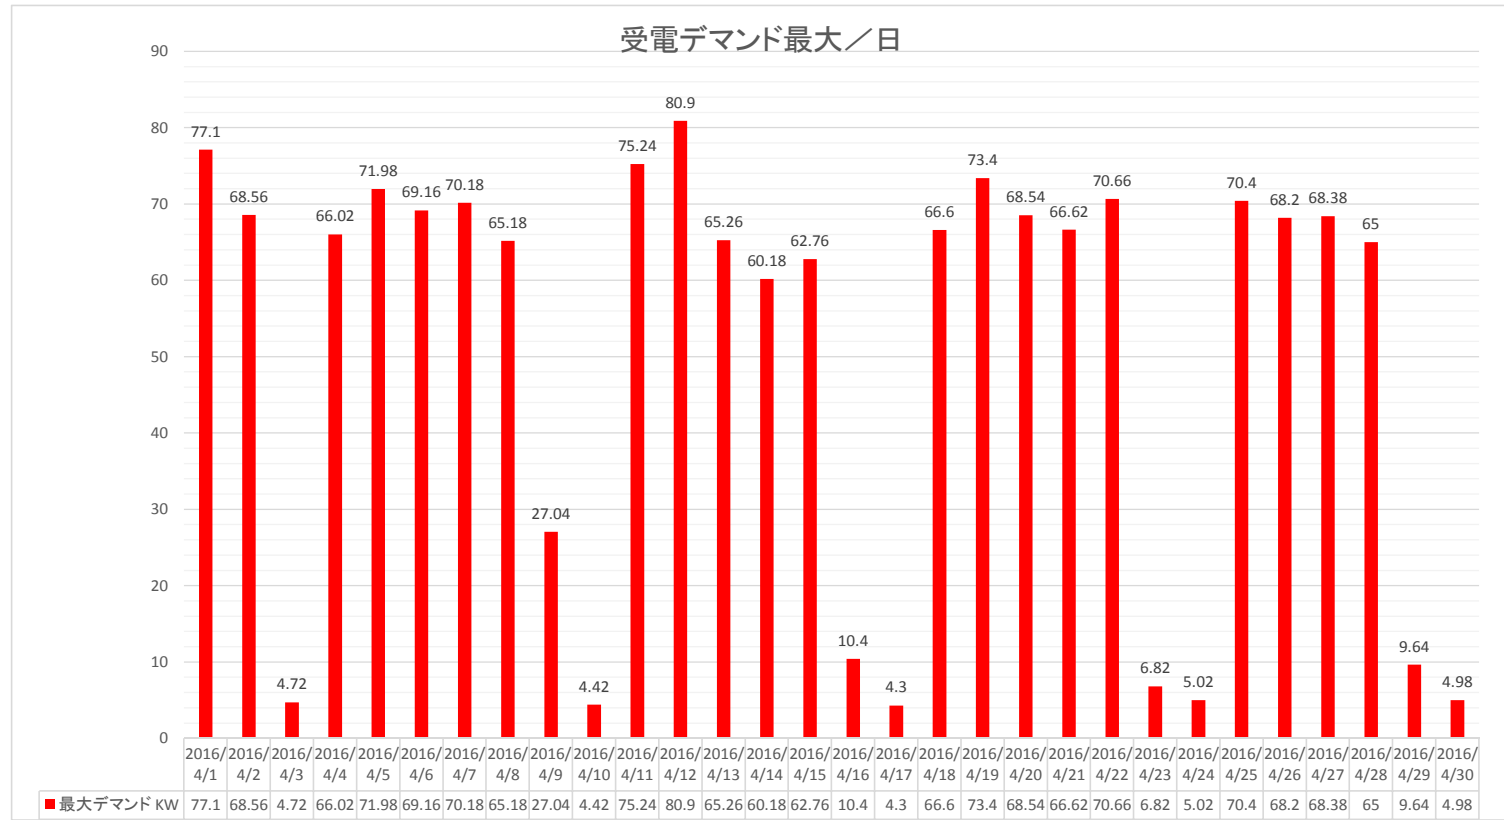

2016年4月4日 最大電力

| 日時 | デマンド値0-30 | デマンド値30-60 | 電力量(kwh) |
|----------------|-----------|------------|----------|
| 2016/4/4 0:00 | 4.1 | 4.06 | 4.08 |
| 2016/4/4 1:00 | 4.32 | 4.28 | 4.3 |
| 2016/4/4 2:00 | 4.24 | 4.24 | 4.24 |
| 2016/4/4 3:00 | 4.2 | 4.24 | 4.22 |
| 2016/4/4 4:00 | 4.28 | 4.2 | 4.24 |
| 2016/4/4 5:00 | 4.24 | 4.28 | 4.26 |
| 2016/4/4 6:00 | 4.18 | 4.08 | 4.13 |
| 2016/4/4 7:00 | 9.86 | 15.62 | 12.74 |
| 2016/4/4 8:00 | 26.24 | 43.96 | 35.1 |
| 2016/4/4 9:00 | 65.04 | 61.92 | 63.48 |
| 2016/4/4 10:00 | 61.52 | 64.7 | 63.11 |
| 2016/4/4 11:00 | 60.66 | 66.02 | 63.34 |
| 2016/4/4 12:00 | 40.46 | 33.7 | 37.08 |
| 2016/4/4 13:00 | 46 | 50.26 | 48.13 |
| 2016/4/4 14:00 | 48.98 | 55.22 | 52.1 |
| 2016/4/4 15:00 | 57.12 | 62.68 | 59.9 |
| 2016/4/4 16:00 | 63.48 | 58.64 | 61.06 |
| 2016/4/4 17:00 | 55.02 | 44.24 | 49.63 |
| 2016/4/4 18:00 | 41.56 | 42.4 | 41.98 |
| 2016/4/4 19:00 | 41.68 | 37.06 | 39.37 |
| 2016/4/4 20:00 | 19.84 | 13.76 | 16.8 |
| 2016/4/4 21:00 | 13.84 | 11.8 | 12.82 |
| 2016/4/4 22:00 | 9.92 | 8.16 | 9.04 |
| 2016/4/4 23:00 | 4.32 | 4.36 | 4.34 |
| 本日最大値(kw) | 66.02 | | |
| 本日電力量(kwh) | | | 699.49 |

